

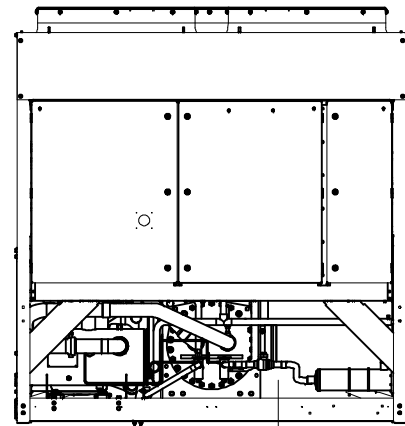


NOTES:

1. PLACEMENT ON A LEVEL SURFACE FREE OF OBSTRUCTIONS (INCLUDING SNOW, FOR WINTER OPERATION) OR AIR RECIRCULATION ENSURES RATED PERFORMANCE, RELIABLE OPERATION AND EASE OF MAINTENANCE. SITE RESTRICTIONS MAY COMPROMISE MINIMUM CLEARANCES INDICATED BELOW, RESULTING IN UNPREDICTABLE AIR FLOW PATTERNS AND POSSIBLE DIMINISHED PERFORMANCE. YORK'S UNIT CONTROLS WILL OPTIMIZE OPERATION WITHOUT NUISANCE HIGH PRESSURE SAFETY CUTOUT; HOWEVER, THE SYSTEM DESIGNER MUST CONSIDER POTENTIAL PERFORMANCE DEGRADATION. RECOMMENDED MINIMUM CLEARANCES: COIL SIDE - 2m COMPRESSOR SIDE - 1.2m; CONTROL SIDE - 2m; TOP - NO OBSTRUCTIONS ALLOWED; DISTANCE BETWEEN ADJACENT UNITS - 3m. NO MORE THEN ONE ADJACENT WALL MAY BE HIGHER THEN THE UNIT.
2. WEIGHTS (KG): SHIPPING - 4,700, OPERATING - 5,000
3. CENTER OF GRAVITY FROM ORIGIN: X= 2558.0, Y= 1357.8
4. INSTALLING CONTRACTOR MUST INCLUDE VENT AND DRAIN ACCOMODATIONS IN CHILLED WATER PIPING NEAR THE EVAPORATOR.

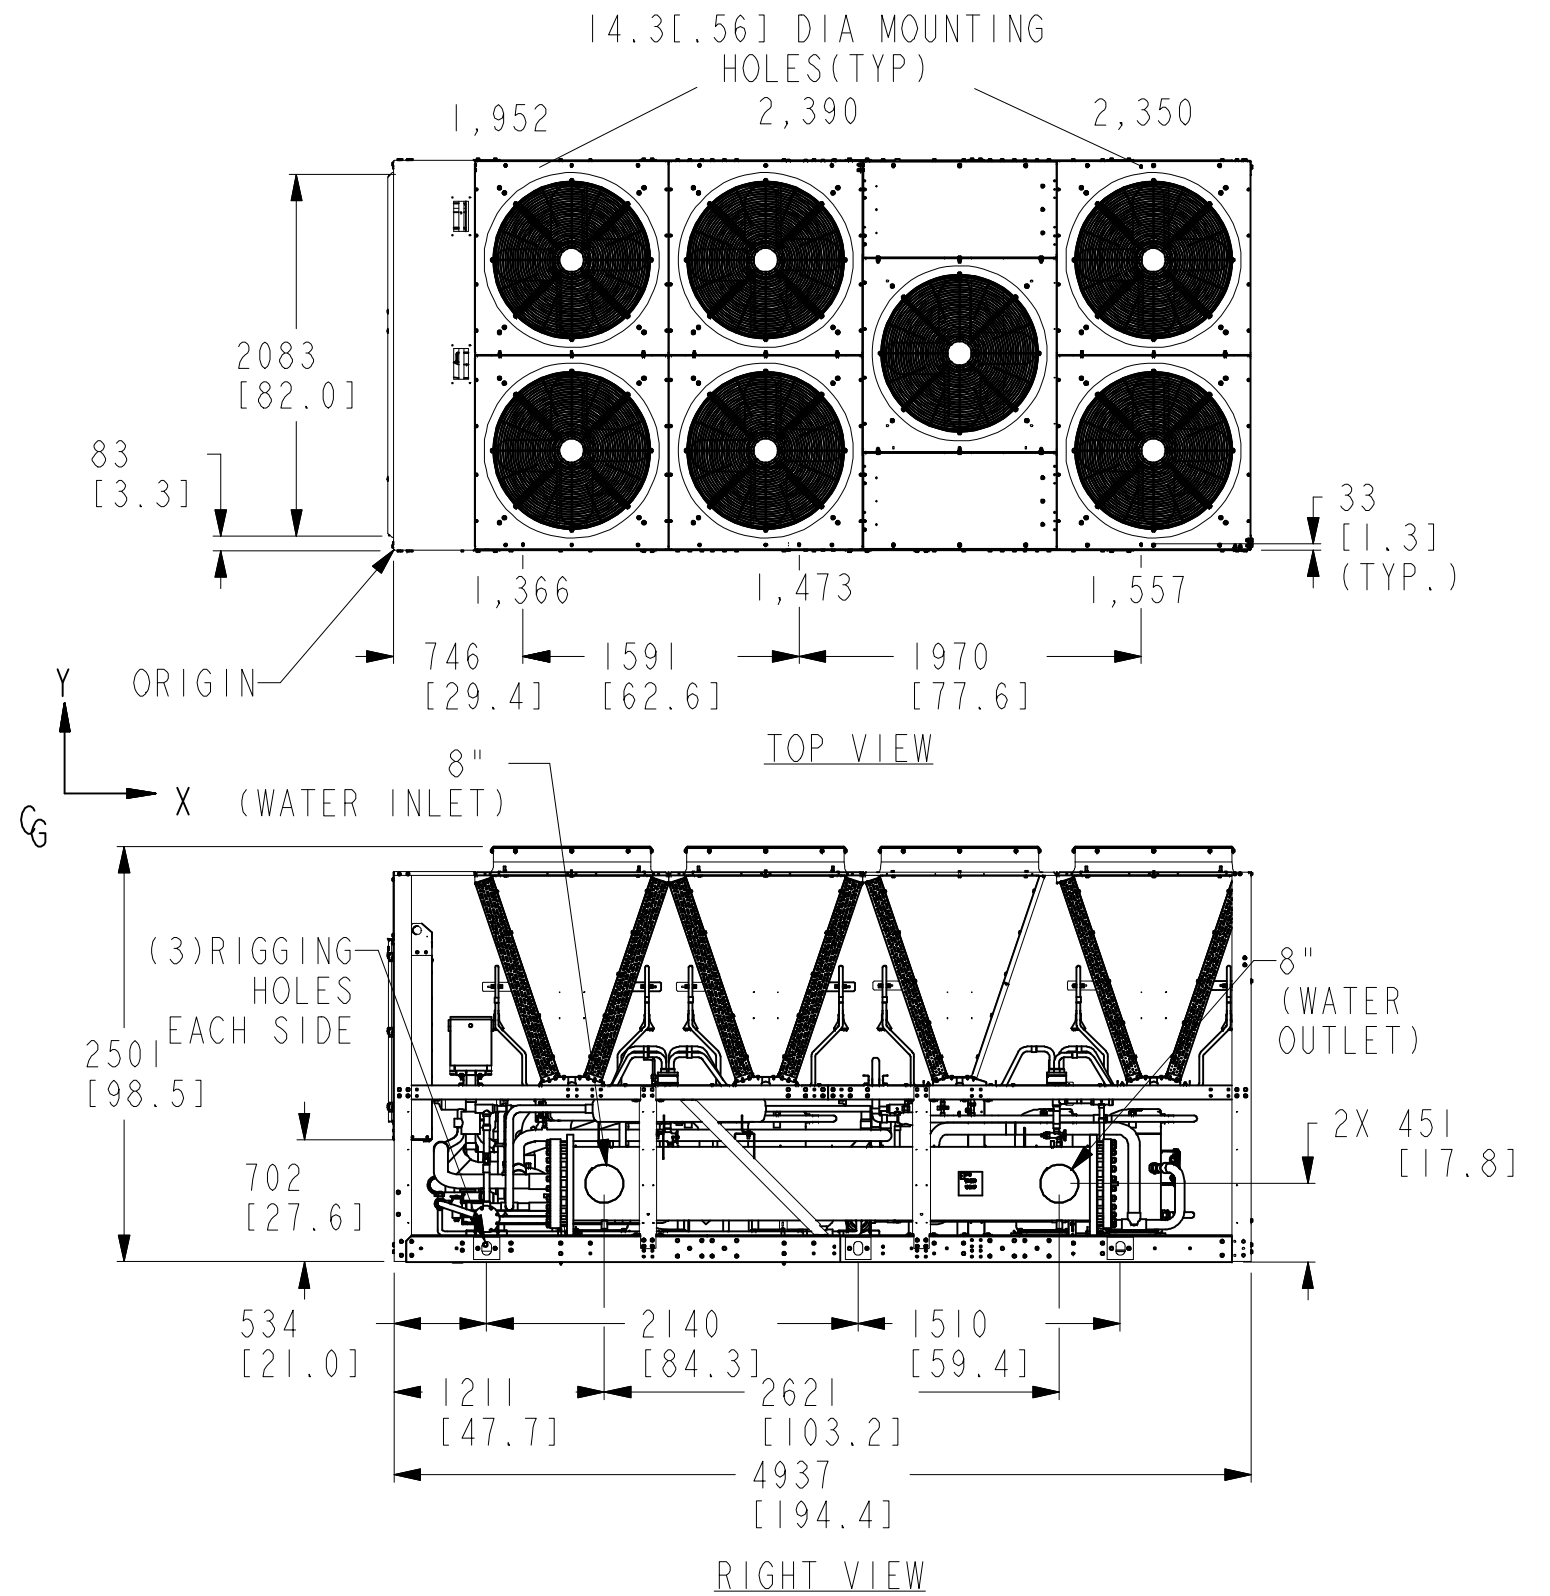

FRONT VIEW
 2246 [88.4] BASE WIDTH
 742 [29.2] TO CLR CONN

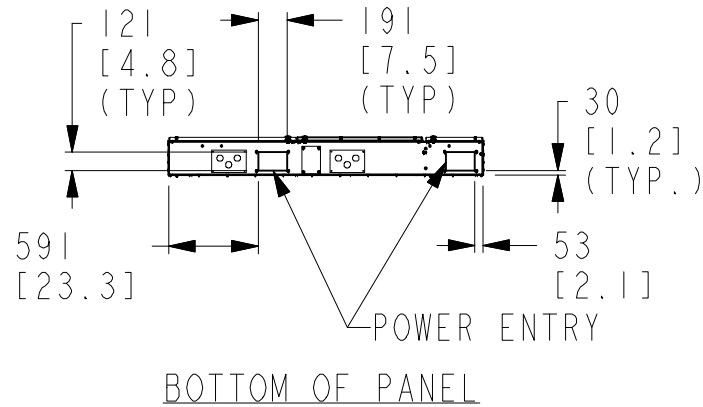

			JOHNSON CONTROLS - BUILDING EFFICIENCY 507 EAST MICHIGAN STREET, MILWAUKEE, WI, 53202 USA											
REVISION A	REV.	DATE	EC. NO.	DR.	CHK.	ENG.	"ALL PROPRIETARY RIGHTS IN THE SUBJECT MATTER HEREOF ARE RESERVED AND NO PERMISSION IS GRANTED TO REPRODUCE THIS PRINT IN WHOLE OR IN ANY PART, OR DISCLOSE ANY OF THE INFORMATION UPON IT TO OTHERS WITHOUT WRITTEN RELEASE BY JOHNSON CONTROLS INCORPORATED"	DO NOT SCALE UNLESS OTHERWISE SPECIFIED, DIMENSIONS ARE IN MILLIMETERS		PRODUCT DRAWING 0415SE CE YLPA		MATERIAL ENG. STD. PART NO. CUT SIZE		
	-		DX10-0324					DRAWN H.S.CHEN 10-SEP-2010 MODELER H.S.CHEN 10-SEP-2010 CHKD Y.ZHANG 10-SEP-2010 ENG	SCALE: 0.091 MASS (kg): SEE ABOVE		CAGE NUMBER 66935		DRAWING NUMBER 075-94325-103	
	NEW								ORIG. NO.:		SHEET 1 OF 1		REVISION VERSION 0	
									A3		075-94325-103		RELEASED	
									SCALE: 0.091 MASS (kg): SEE ABOVE		ORIG. NO.:		SHEET 1 OF 1	